
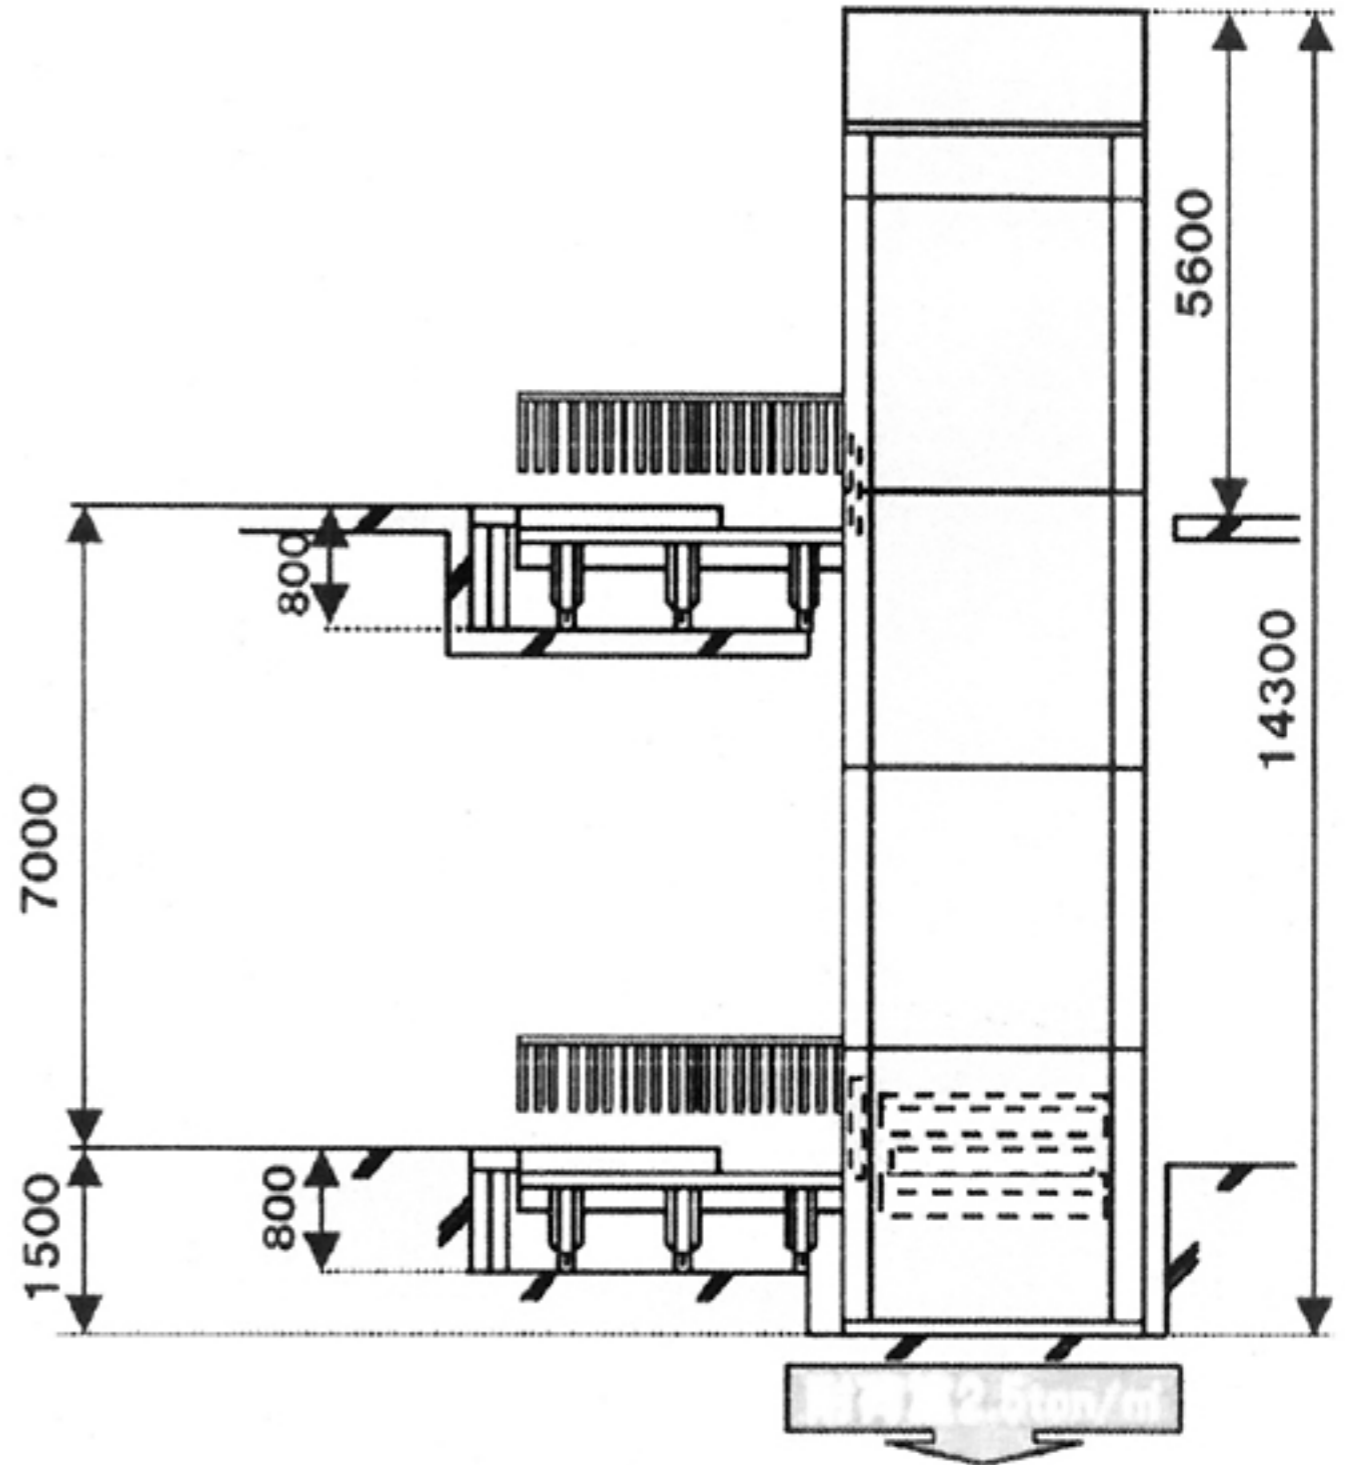


# Reference Diagrams

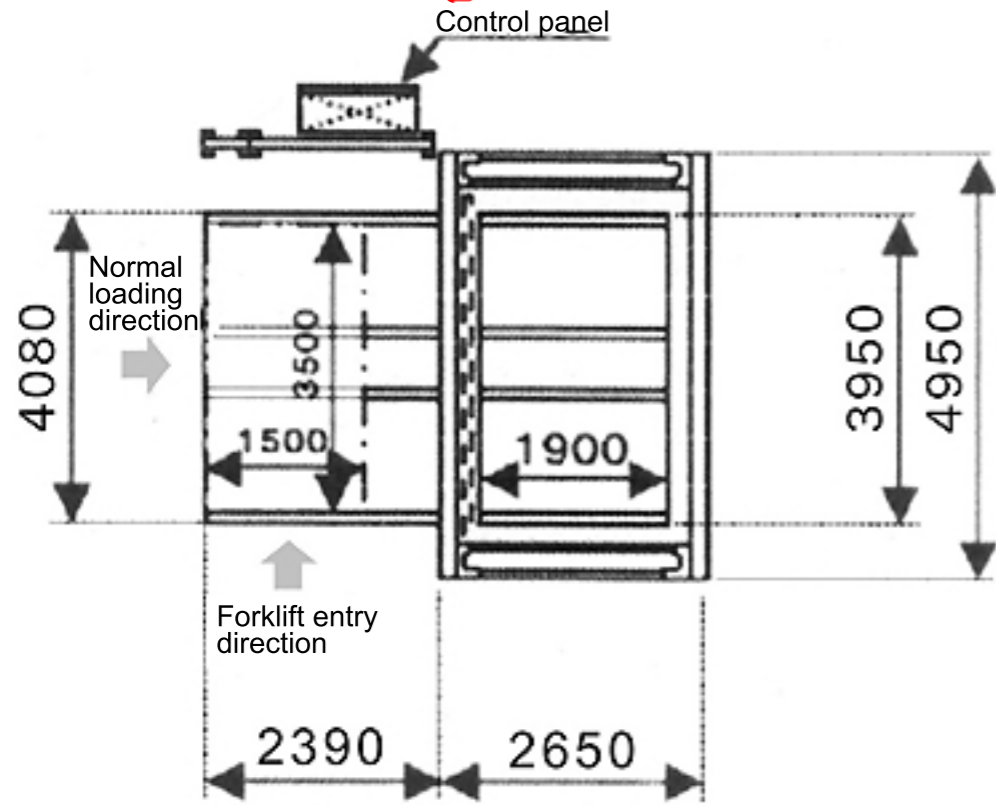

\*Fireproof shutters interlocked with the smoke detector system are required if fireproof divisions are required.